

# Monitoring Relays Pump alternating Type DLA71

CARLO GAVAZZI



- Pump alternating relay for 2 or 3 pumps
- Output: 5 A SPST relay
- For mounting on DIN-rail in accordance with DIN/EN 50 022
- 35.5 mm DIN-rail housing
- LED indication for relay and power supply ON
- Galvanically separated power supply
- Built-in delay for the second or third pump in case simultaneous activation is required
- Built-in function for automatic rotation of the pumps

## Product Description

DLA71 is relay made to alternate 2 or 3 pumps in a multiple pump system. In case of need (i.e.: overflow) the second, or even the third pump can be activated together with the first one. In case more than one pump is required to start at the same time, the pumps start 10 s after the previous to


avoid big inrush current.

The LED's indicate the state of the alarm and the output relay.

35.5 mm wide housing suitable both for back and front panel mounting.

## Ordering Key

**DLA 71 T B23 3P**

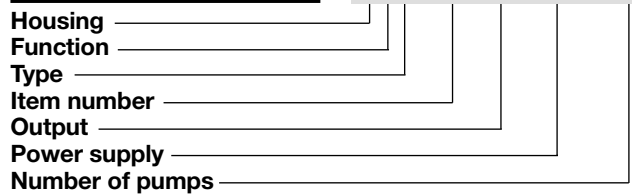

## Type Selection

Mounting	Output	Function	Supply: 24/48 VAC	Supply: 115/230 VAC
DIN-rail	2 x SPST	For two pumps	<b>DLA 71 D B48 2P</b>	<b>DLA 71 D B23 2P</b>
DIN-rail	3 x SPST	For three pumps	<b>DLA 71 T B48 3P</b>	<b>DLA 71 T B23 3P</b>

## Input Specifications

Contact input	Terminals
DLA71...2P (normal mode)	
ON/OFF 1 pump	C, S1
ON/OFF 2 pumps	C, S2
DLA71...2P (differential mode)	
first pump starts	C, S1
first pump stops	C, S3
second pump start	C, S2
second pump stop	C, S4
DLA71...3P (normal mode)	
ON/OFF 1 pump	C, S1
ON/OFF 2 pumps	C, S2
ON/OFF 3 pumps	C, S3
DLA71...3P (full mode)	
ON 1 pump	C, S1
ON 2 pumps	C, S2
ON 3 pumps	C, S3
OFF all pumps	C, S4
Disabled	> 10 kΩ
Enabled	< 1 kΩ
Voltage	< 25 V
Current	< 2 mA

## Output Specifications

<b>Output</b>	DLA71...2P	2 x SPST NO relay
	DLA71...3P	3 x SPST NO relay
Rated insulation voltage		250 VAC
<b>Contact ratings (AgSnO<sub>2</sub>)</b>		μ
Resistive loads AC 1		5 A @ 250 VAC
		DC 12 5 A @ 24 VDC
Small inductive loads AC 15		2.5 A @ 250 VAC
		DC 13 2.5 A @ 24 VDC
<b>Mechanical life</b>		≥ 30 x 10 <sup>6</sup> operations
<b>Electrical life</b>		≥ 10 <sup>5</sup> operations (at 5 A, 250 V, cos φ = 1)
<b>Operating frequency</b>		≤ 7200 operations/h
<b>Dielectric strength</b>		
Dielectric voltage		2 kVAC (rms)
Rated impulse withstand volt.		4 kV (1.2/50 μs)



## Supply Specifications

<b>Power supply</b> Rated operational voltage through terminals: A1, A2 or A3, A2	Overvoltage cat. III (IEC 60664, IEC 60038)
B48:	24/48 VAC ± 15% 45 to 65 Hz, insulated
B23:	115/230 VAC ± 15% 45 to 65 Hz, insulated
<b>Dielectric voltage</b> Supply to input Supply to output Input to output	4 kV (1.2/50 µs) 4 kV (1.2/50 µs) 4 kV (1.2/50 µs)
<b>Rated operational power</b> AC	3 VA

## General Specifications

<b>Reaction time</b> Closing input Opening input Minimum delay to activate the rescue pumps	< 100 ms < 100 ms 10 s
<b>Continuous working time to activate the rotation pumps</b>	6 h ± 10%
<b>Indication for</b> Power supply ON Pump 1 ON Pump 2 ON Pump 3 ON (DLA71...3P)	LED, green, steady as above, flashing 1 Hz as above, flashing 2 Hz as above, flashing 3 Hz Note: if more than one pump is active, the indication refers to the pump started last.
<b>Environment</b> Degree of protection Pollution degree Operating temperature Storage temperature	(EN 60529) IP 20 3 -20 to 60°C, R.H. < 95% -30 to 80°C, R.H. < 95%
<b>Housing dimensions</b>	35.5 x 81 x 67.2 mm
<b>Weight</b>	Approx. 135 g
<b>Screw terminals</b> Tightening torque	Max. 0.5 Nm acc. to IEC 60947
<b>CE Marking</b>	Yes
<b>EMC</b> Immunity Emission	Electromagnetic Compatibility According to EN 61000-6-2 According to EN 50081-1

## Mode of Operation

DLA71 is made for pumping systems where 2 or 3 pumps are in parallel. It let the pumps work alternatively, allowing more pumps to work together in case of need.

### Example 1

(emptying a basin, 2-pump system)

As soon as the liquid reaches switch S1 one pump starts. As soon as S1 switches back the pump stops. When switch S1 is activated again the other pump starts allowing uniform consumption of all the pumps. If switch S2 is activated both pumps start (2 pumps running at the same time). When S2 switches back the pump running since most time stops.

### Example 2

(emptying a basin, 2-pump

system, differential mode)  
In this case the pumps are separately started and stopped by the two pairs of switches S1, S2 and S3, S4. Appropriate positioning allows the pumps to work together in case of need.

### Note (2-pump system)

If the system is continuously working with only one pump, after working for 6 hours, DLA71 stops the pump and the second one automatically starts. This rotation is repeated every 6 hours of single and continuative work of a pump.

### Example 3

(emptying a basin, 3-pump system, normal mode)

The system works exactly as described in example 1 except that if switch S3 is

reached three pumps work at the same time. When they switch back the pumps are turned off in sequence starting from the one running longer.

### Example 4

(emptying a basin, 3-pump system, full mode)

As soon as the liquid reaches switch S1 one pump starts. When it drops below switch S4 it stops. If switch S1 is triggered again another pump starts. If switch S2 is activated a second pump starts (rescue pump). If switch S3 is activated all the pumps operate. The only switch to stop all the pumps active at a certain time is S4.

### Note (3-pump system)

If the system is continuously working with only one pump, after working for 6 hours,

DLA71 stops the pump and the second one automatically starts. If also the second pump works continuously alone for 6 hours, it is stopped and the third pump is then started.


If a couple of pumps is continuously working for 6 hours, the one running for more time stops and the free one starts.

This rotation is repeated every 6 hours of continuative work of a pump or a couple of pumps.



### Note (2 and 3-pump systems)

In case the task is to fill a basin, all the switches are reversed in the basin itself.



# Wiring Diagrams

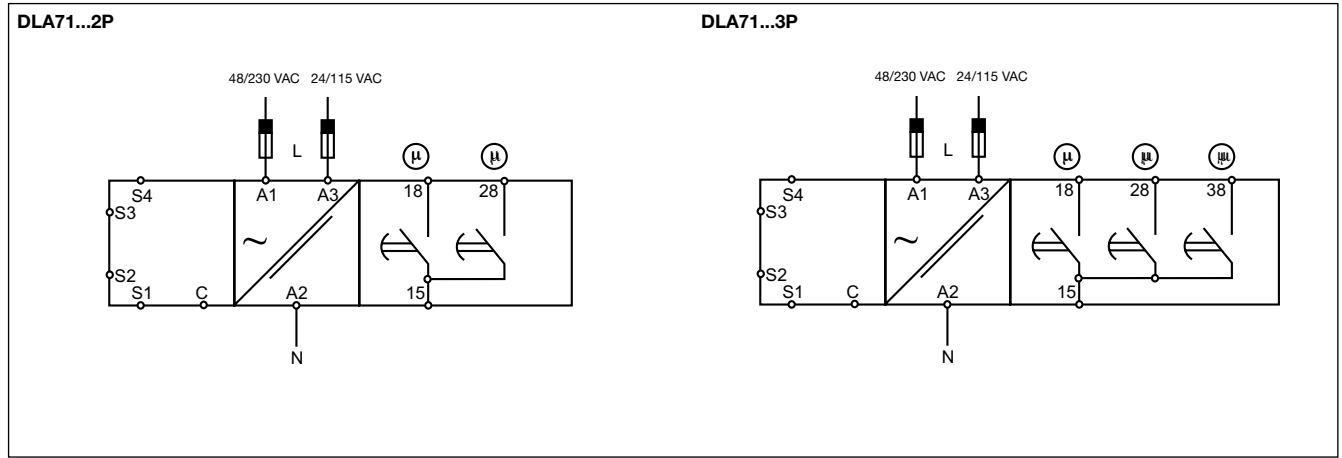

# Operation Diagrams

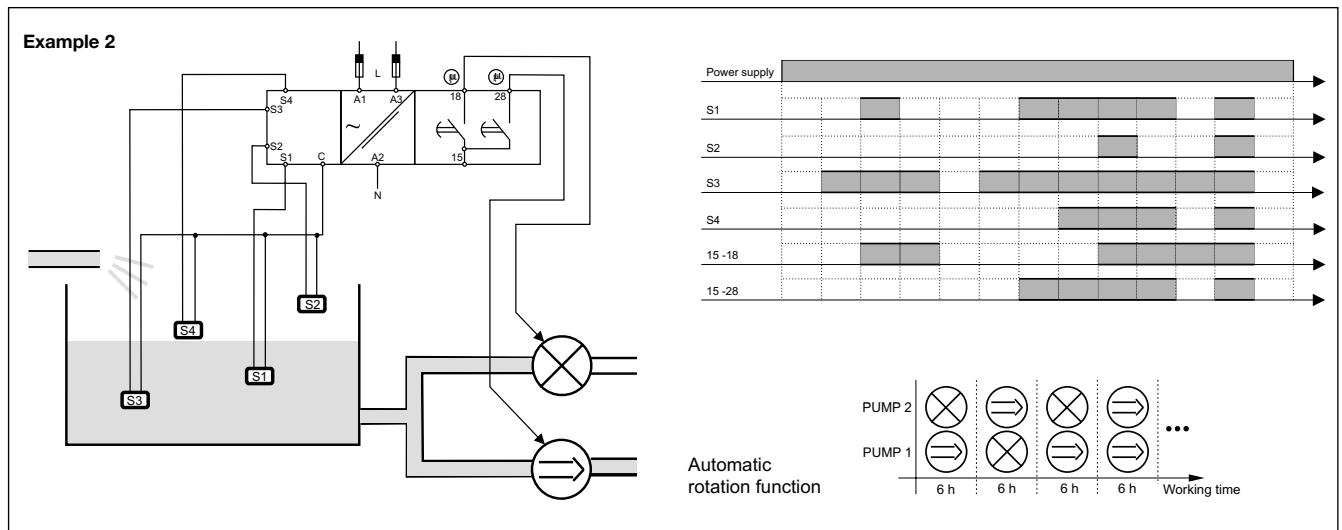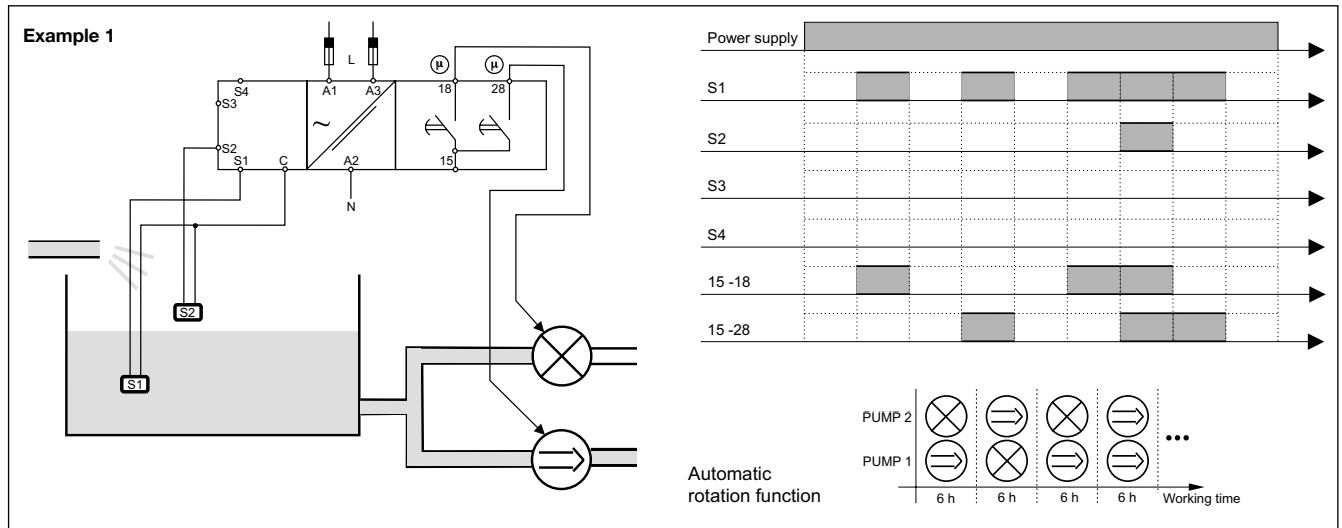

## Operation Diagrams

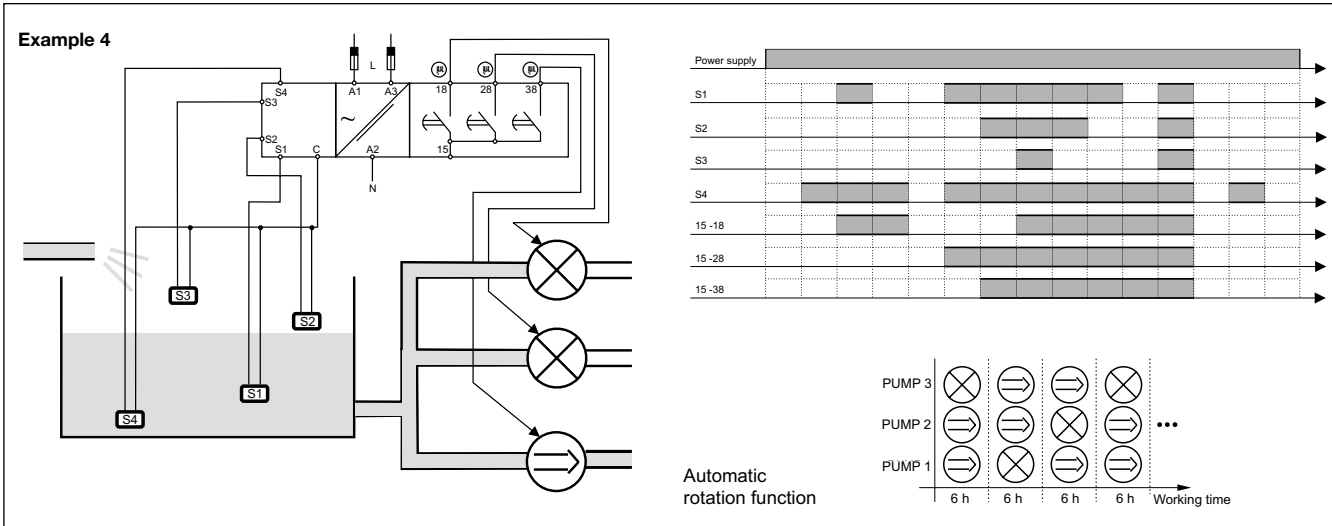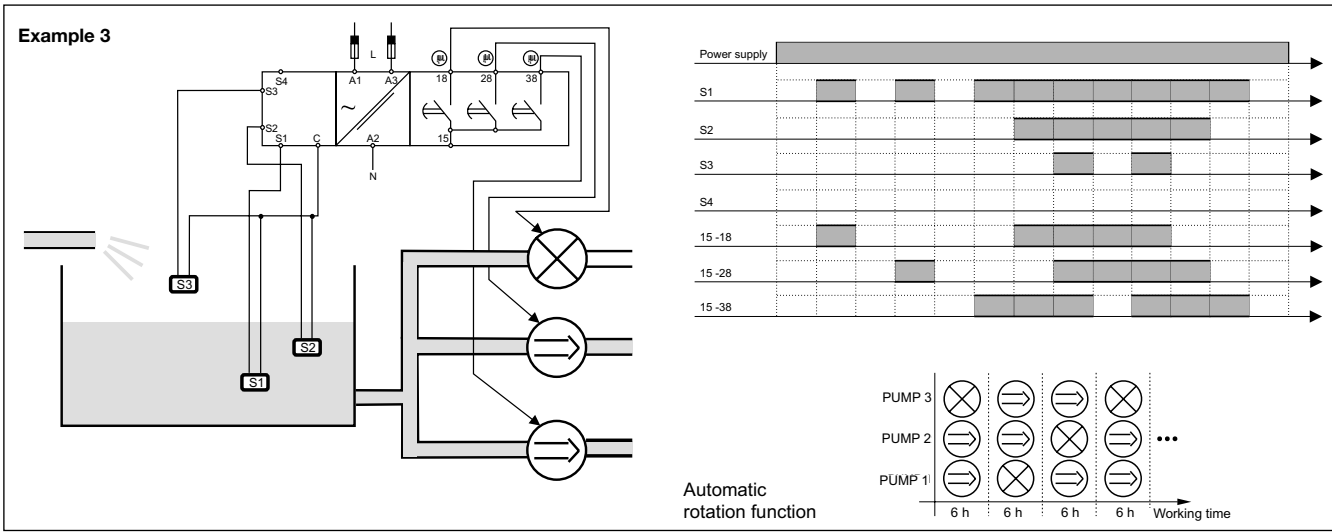

## Dimensions

